



Multi-turn gearboxes GST 10.1 – GST 40.1



Read operation instructions first.

- Observe safety instructions.
- These operation instructions are part of the product.
- Store operation instructions during product life.
- Pass on instructions to any subsequent user or owner of the product.

Target group:

This document contains information for assembly, commissioning and maintenance staff.

Table of contents	Page
1. Safety instructions.....	3
1.1. Basic information on safety	3
1.2. Range of application	4
1.3. Warnings and notes	4
1.4. References and symbols	4
2. Short description.....	5
3. Name plate.....	6
4. Transport and storage.....	9
4.1. Transport	9
4.2. Storage	11
5. Assembly.....	12
5.1. Mounting position	12
5.2. Handwheel fitting	12
5.3. Multi-turn actuators for motor operation	12
5.4. Mount gearbox to valve	14
5.4.1. Overview of output drive types	14
5.4.2. Output drive type A	14
5.4.2.1. Mount gearbox with output drive type A to valve	14
5.4.2.2. Finish machining of stem nut for output drive type A	16
5.4.3. Output drive types B/C/D and E	17
5.4.3.1. Mount gearbox with output drive types B to valve	18
5.5. Accessories for assembly	19
5.5.1. Stem protection tube for rising valve stem	19
6. Commissioning.....	20
6.1. Seating via multi-turn actuator	20
7. Servicing and maintenance.....	21
7.1. Preventive measures for servicing and safe operation	21
7.2. Maintenance intervals	21
7.3. Disposal and recycling	21
8. Technical data.....	23
8.1. Technical data Multi-turn gearboxes	23
9. Spare parts.....	26
9.1. Multi-turn gearboxes GST 10.1 – GST 16.1	26
9.2. Multi-turn gearboxes GST 25.1 – GST 40.1	28
Index.....	30

1. Safety instructions

1.1. Basic information on safety

Standards/directives	Our products are designed and manufactured in compliance with recognised standards and directives. This is certified in a Declaration of Incorporation and an EU Declaration of Conformity. The end user or the contractor must ensure that all legal requirements, directives, guidelines, national regulations and recommendations with respect to assembly, electrical connection, commissioning and operation are met at the place of installation.
Safety instructions/warnings	All personnel working with this device must be familiar with the safety and warning instructions in this manual and observe the instructions given. Safety instructions and warning signs on the device must be observed to avoid personal injury or property damage.
Qualification of staff	Assembly, electrical connection, commissioning, operation, and maintenance must be carried out exclusively by suitably qualified personnel having been authorised by the end user or contractor of the plant only. Prior to working on this product, the staff must have thoroughly read and understood these instructions and, furthermore, know and observe officially recognised rules regarding occupational health and safety. Work performed in potentially explosive atmospheres is subject to special regulations which have to be observed. The end user or contractor of the plant are responsible for respect and control of these regulations, standards, and laws.
Electrostatic charging	Highly efficient charge generating processes (processes more efficient than manual friction) on the device surface must be excluded at any time, since they will lead to propagating brush discharges and therefore to ignition of a potentially explosive atmosphere. This also applies to fireproof coatings or covers available as an option.
Ignition hazards	Gearboxes were subjected to an ignition hazard assessment in compliance with the currently applicable standard according to ISO 80079-36/ -37 / -38. Hot surfaces, mechanically generated sparks as well as static electricity and stray electric currents were identified and assessed as major potential ignition sources. Protective measures to prevent the likelihood that ignition sources arise were applied to the gearboxes. This includes in particular lubrication of the gearbox, the IP protection codes and the warnings and notes contained in these operation instructions.
Commissioning	Prior to commissioning, it is important to check that all settings meet the requirements of the application. Incorrect settings might present a danger to the application, e.g. cause damage to the valve or the installation. The manufacturer will not be held liable for any consequential damage. Such risk lies entirely with the user.
Operation	Prerequisites for safe and smooth operation: • Correct transport, proper storage, mounting and installation, as well as careful commissioning. • Only operate the device if it is in perfect condition while observing these instructions. • Immediately report any faults and damage and allow for corrective measures. • Observe recognised rules for occupational health and safety. • Observe the national regulations. • During operation, the device warms up and increased surface temperature may occur. To prevent possible burns, we recommend checking the surface temperature using an appropriate thermometer and wearing protective gloves, if required, prior to working on the device.
Protective measures	The end user or the contractor are responsible for implementing required protective measures on site, such as enclosures, barriers, or personal protective equipment for the staff.

- Maintenance** To ensure safe device operation, the maintenance instructions included in this manual must be observed.
- Any device modification requires prior written consent of the manufacturer.

1.2. Range of application

AUMA multi-turn gearboxes are designed for the operation of industrial valves, e.g. gate valves and globe valves.

Other applications require explicit (written) confirmation by the manufacturer.

The following applications are not permitted, e.g.:

- Industrial trucks according to EN ISO 3691
- Lifting appliances according to EN 14502
- Passenger lifts according to DIN 15306 and 15309
- Service lifts according to EN 81-1/A1
- Escalators
- Continuous duty
- Radiation exposed areas in nuclear power plants

No liability can be assumed for inappropriate or unintended use.

Observance of these operation instructions is considered as part of the device's designated use.

1.3. Warnings and notes

The following warnings draw special attention to safety-relevant procedures in these operation instructions, each marked by the appropriate signal word (DANGER, WARNING, CAUTION, NOTICE).



Indicates an imminently hazardous situation with a high level of risk. Failure to observe this warning results in death or serious injury.



Indicates a potentially hazardous situation with a medium level of risk. Failure to observe this warning could result in death or serious injury.



Indicates a potentially hazardous situation with a low level of risk. Failure to observe this warning could result in minor or moderate injury. May also be used with property damage.



Potentially hazardous situation. Failure to observe this warning could result in property damage. Is not used for personal injury.

Safety alert symbol  warns of a potential personal injury hazard.

The signal word (here: DANGER) indicates the level of hazard.

1.4. References and symbols

The following references and symbols are used in these instructions:

Information The term **Information** preceding the text indicates important notes and information.



Symbol for CLOSED (valve closed)



Symbol for OPEN (valve open)



Result of a process step

Describes the result of a preceding process step.

2. Short description

AUMA spur gearboxes are multi-turn gearboxes transmitting a rotary movement to the valve. They are driven either via electric motor (by means of a multi-turn actuator) or manually (via a handwheel). The drive axle operates at an offset to the output drive axle.

3. Name plate

Figure 1: Arrangement of name plates



- [1] Gearbox name plate
- [2] Approval plate in explosion-proof version
- [3] Additional plate, e.g. KKS plate (Power Plant Classification System)

Description of gearbox name plate

Figure 2: Gearbox name plate (example of GST 10.1)



- [1] Name of manufacturer
- [2] Address of manufacturer
- [3] **Type designation** – valve attachment (flange)
- [4] **Order number**
- [5] **Serial number**
- [6] **Reduction ratio**
- [7] **Factor**
- [8] Max. output torque
- [9] Type of lubricant
- [10] Permissible ambient temperature
- [11] **Explosion protection version** (option)
- [12] Can be assigned as an option upon customer request
- [13] **Data Matrix code**
- [14] Enclosure protection

Type designation Figure 3: Type designation (example)



- 1. Type and size of gearbox
- 2. Flange size (valve attachment)

Type and size

These instructions apply to the following device types and sizes:

Spur gearboxes of **GST** type, sizes **10.1 – 40.1**

Order number

The product can be identified using this number and the technical data as well as order-related data pertaining to the device can be requested.

Please always state this number for any product inquiries.

On the Internet at <http://www.auma.com> > Service & Support > myAUMA, we offer a service allowing authorised users to download order-related documents such as wiring diagrams and technical data (both in German and English), inspection certificate and the operation instructions when entering the order number.

Serial number

Table 1:

Description of serial number up to 2022 (example of 2622MK12345)			
26	22	MK12345	
26	Positions 1+2: Assembly in week = week 26		
	22	Position 3+4: Year of manufacture = 2022	
		MK12345	Internal number for unambiguous product identification

Table 2:

Description of serial number as from 2023 (example of 0000-00101-2023)			
0000-00101	–	2023	
0000-00101			Serial number of sales articles 11-digit, internal number for unambiguous product identification
		2023	Year of manufacture 2023

Reduction ratio

The reduction ratio within gearing reduces the required input torques and increases the operating time.

Factor

Mechanical conversion factor for actuator size determination:

Input torque = required valve torque (output torque)/factor

Explosion protection version (option)

The explosion protection version is either indicated on the name plate of the gearbox or on a separate approval plate.

Figure 4: Separate name plate for explosion-proof version (example)



[1] Ex symbol, CE mark

Classification:

[2] Gas explosion protection

[3] Dust explosion protection

Data Matrix code

When registered as authorised user, you may use our **AUMA Assistant App** to scan the Data Matrix code and directly access the order-related product documents without having to enter order number or serial number.

Figure 5: Link to AUMA Assistant App:




For further Service & Support, Software/Apps/... refer to www.auma.com

Marking of special version for counterclockwise closing (option)

In the standard version, the direction of rotation at input shaft corresponds to the direction of rotation at valve shaft (clockwise version). In order to reverse the direction of rotation e.g. for a counterclockwise closing valve, an AUMA reversing gearbox of the GW 14.1 type can be mounted between multi-turn actuator and gearbox. Up to size GST 30.1, the direction of rotation can be selected when ordering. For these sizes, the direction of rotation is marked on the order-related technical data sheet as "CCW" or "CW". For the "CCW" special version, a label for the direction of rotation is additionally attached to the handwheel.

Figure 6: Marking on handwheel.



4. Transport and storage

4.1. Transport

For transport to place of installation, use sturdy packaging.

Transport gearbox and actuator separately.



Suspended load!

Death or serious injury.

- Do NOT stand below suspended load.
- Fix ropes or slings on gearbox housing, NOT to handwheel, actuator, or actuator controls.
- Check eyebolts for tight seat in housing (verify reach of the screw).
- Observe manufacturer specifications for fixing lifting straps and round slings.
- Respect total weight of combination (gearbox, actuator, actuator controls, output drive).
- Eyebolts are exclusively permitted for the weight of the represented arrangements of the respective sizes.
- Secure load against falling down, sliding or tilting.
- Perform lift trial at low height to eliminate any potential danger e.g. by tilting.

GST 10.1 – GST 16.1

Up to size 16.1, the gearboxes are supplied mounted to the actuator and the output drive types A and AF when leaving the factory. Lifting straps/round slings are wound around the input mounting flange for both horizontal and vertical suspension.


Figure 7: Example of GST 14.1, vertical suspension



GST 25.1 and GST 30.1

Actuators for worm gearboxes GST 25.1 and GST 30.1 are always supplied separately when leaving the factory and must be transported and lifted separately. Unless specified otherwise by the customer, output drive types A and AF are mounted to the gearbox. Sizes 25.1 and 30.1 leave the factory with fitted eyebolts. The gearbox is either vertically suspended via round slings/lifting straps or horizontally via eyebolts.

Figure 8: Example of GST 30.1 with horizontal and vertical suspension

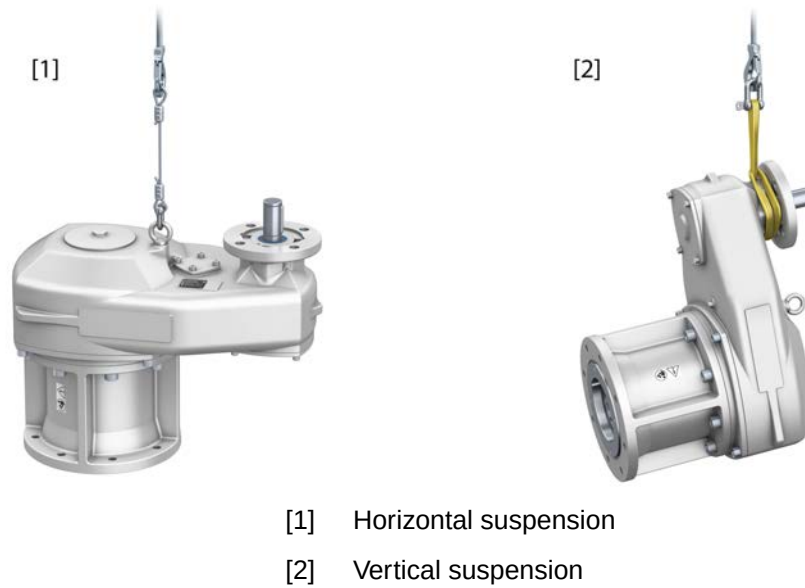

GST 35.1 and GST 40.1

Actuators for gearbox sizes GST 35.1 and GST 40.1 as well as output drive types A and AF are always supplied separately when leaving the factory and must be transported and lifted separately. Sizes 35.1 and 40.1 leave the factory with fitted eyebolts. Suspension is made either vertically via round slings/lifting straps or horizontally via the eye nut.

Figure 9: Example of GST 40.1 with horizontal and vertical suspension

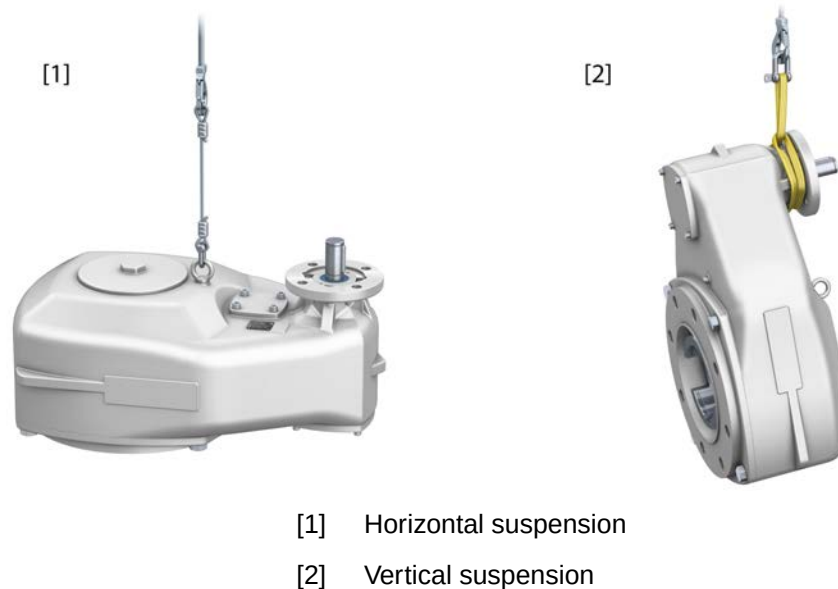


Table 3: Gearbox weight with output drive sleeve (without bore) and grease filling in the gear housing

Type	Weight [kg]
GST 10.1	14
GST 14.1	26
GST 14.5	26
GST 16.1	40
GST 25.1	82
GST 30.1	115
GST 35.1	195
GST 40.1	255

Table 4:

Weights for output drive type		
Type designation	Flange size	[kg]
A 10.2	F10	2.8
A 14.2	F14	6.8
A 16.2	F16	11.7
A 25.2	F25	42
A 30.2	F30	69
A 35.2	F35	126
A 40.2	F40	202

Table 5:

Weights for output drive type		
Type designation	Flange size	[kg]
AF 07.2	F10	5.2
AF 07.6	F10	5.2
AF 10.2	F10	5.5
AF 14.2	F14	13.7
AF 16.2	F16	23
AF 25.2	F25	61
AF 30.2	F30	103
AF 35.2	F35	180
AF 40.2	F40	320

For the actuator and actuator controls weights, refer to the respective operation instructions.

4.2. Storage

NOTICE

Risk of corrosion due to inappropriate storage!

- Store in a well-ventilated, dry room (maximum humidity 70 %).
- Protect against floor dampness by storage on a shelf or on a wooden pallet.
- Cover to protect against dust and dirt.
- Apply suitable corrosion protection agent to uncoated surfaces.

Long-term storage

For long-term storage (more than 6 months), observe the following points:

1. Prior to storage:
Protect uncoated surfaces, in particular the output drive parts and mounting surface, with long-term corrosion protection agent.
2. At an interval of approx. 6 months:
Check for corrosion. If first signs of corrosion show, apply new corrosion protection.

5. Assembly


5.1. Mounting position

The product described in this document can be operated without restriction in any mounting position.

5.2. Handwheel fitting

Gearboxes designed for manual operation are supplied with a separate handwheel. Fitting is performed on site according to the description below.

Figure 10: Handwheel

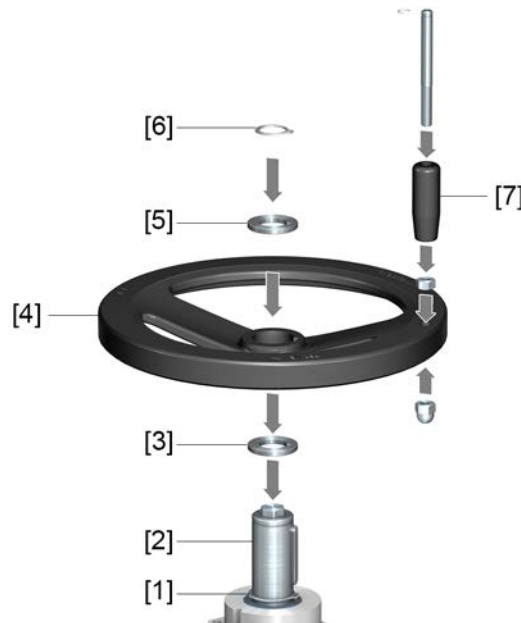

- [1] Retaining ring for input shaft (partly required)
- [2] Gear input shaft
- [3] Spacer (partly required)
- [4] Handwheel
- [5] Spacer (partly required)
- [6] Retaining ring
- [7] Ball handle

- How to proceed**
1. For input shafts with keyway: Fit retaining ring [1] on input shaft [2].
 2. If required, fit spacer [3].
 3. Slip handwheel [4] onto input shaft.
 4. If required, fit spacer [5].
 5. Secure handwheel [4] using the retaining ring [6] supplied.
 6. Fit ball handle [7] to handwheel.


5.3. Multi-turn actuators for motor operation

Refer to the operation instructions pertaining to the multi-turn actuator for indications on how to mount multi-turn actuators to gearboxes.

This chapter supplies basic information and instructions which should be observed in addition to the operation instructions of the multi-turn actuator.

- Mounting positions** When delivered with AUMA multi-turn actuators, the multi-turn actuator-gearbox combination is delivered in the ordered mounting position up to size GST 16.1. As of size GST 25.1, multi-turn actuator and gearbox are delivered separately.

Figure 11: Mounting positions A – D

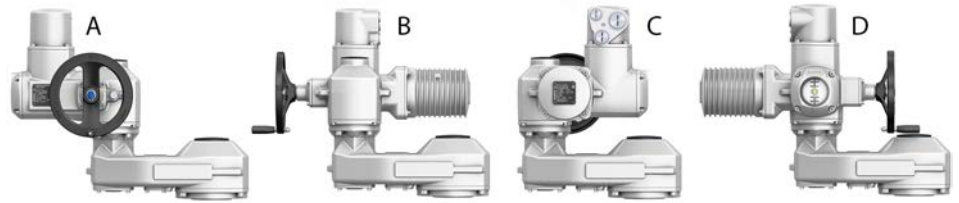

Restriction: For rising valve stem and specific handwheel sizes, mounting position D is not possible.

Information

Refer to the technical data section at the end of the document for possible combinations with multi-turn actuators.

Screws to multi-turn actuator

Screws are included in the scope of delivery of the gearbox for mounting AUMA multi-turn actuators. When mounting other multi-turn actuators, the screws might be either too long or too short (insufficient reach of screws).

**Risk of actuator falling off in case inappropriate screws used should shear.**

Risk of death or serious injury!

→ Check length of screws.


The reach of screws must be sufficient for the internal threads to ensure the supporting strength of the multi-turn actuator and to accept the lateral forces due to the applied torque.

Screws which are too long could make contact with the housing parts, presenting the risk that the multi-turn actuator performs a radial shift with respect to the gearbox. This can lead to shearing of the screws.

Mount input mounting flange

A flange is required for mounting a multi-turn actuator. Depending on the version, the flange for mounting the multi-turn actuator is already fitted in the factory.

Figure 12: Mount flange to multi-turn gearbox



- [1] Gearbox
- [2] Parallel pin
- [3] Input mounting flange

Assembly steps

1. Clean mounting faces, thoroughly degrease uncoated mounting surfaces.
2. Mount parallel pin [2].
3. Place input mounting flange [3] and fasten with screws.
4. Tighten screws crosswise with a torque according to table <Tightening torques for screws> .
5. Place the multi-turn actuator on the spur gearbox and mount according to the multi-turn actuator's operation instructions. Ensure that the spigot fits uniformly in the recess and that the mounting faces are in complete contact.

Information: The multi-turn actuator can be positioned on the valve at every 90°.

6. Fasten screws crosswise to a torque according to table.

Table 6: Tightening torques for screws
(for mounting multi-turn actuator and input mounting flange)

Screws Threads	Tightening torque T_A [Nm]
	Strength class A2-80
M8	24
M10	48
M12	82
M16	200
M20	392

5.4. Mount gearbox to valve


5.4.1. Overview of output drive types

Table 7: Overview on output drive types

Valve attachment	Application	Description
A	- for rising, non-rotating valve stem - capable of withstanding thrust - not appropriate for radial forces	⇒ page 14, Output drive type A
B, B1 – B4 C D E	- for rotating, non-rising valve stem - not capable of withstanding thrust	⇒ page 17, Output drive types B/C/D and E

5.4.2. Output drive type A

Figure 13: Output drive type A (example of A 10.2)

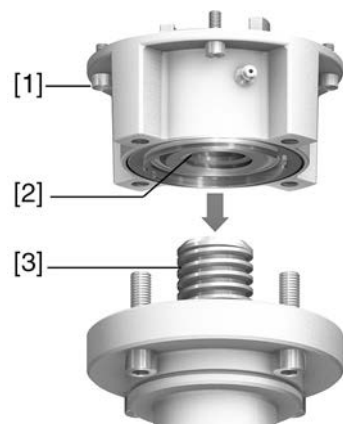

- [1] Output mounting flange
- [2] Stem nut
- [3] Valve stem

Short description

Output drive type A consisting of output mounting flange [1] with axial bearing stem nut [2]. The stem nut transmits the torque from the actuator hollow shaft to the valve stem [3]. Output drive type A can withstand thrusts.


To adapt the actuators to available output drive types A with flanges F10 and F14 (year of manufacture 2009 and earlier), an adapter is required. The adapter can be ordered from AUMA.

5.4.2.1. Mount gearbox with output drive type A to valve

1. If output drive type A is already mounted to the gearbox: Loosen screws and remove output drive type A.
2. Check if the flange of output drive type A matches the valve flange [4].
3. Apply a small quantity of grease to the valve stem.


4. Place output drive type A on valve stem and turn until it is flush on the valve flange.
5. Turn output drive type A until alignment of the fixing holes.
6. Fasten screws [5] between valve and output drive type A [2] without completely tightening them.

Figure 14: Example of output drive A 10.2

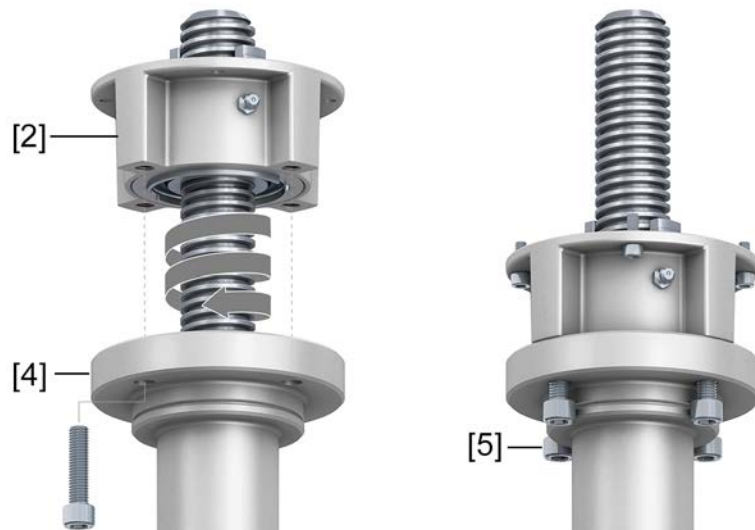

7. Fit gearbox on the valve stem so that the stem nut dogs engage into the output drive sleeve.
- ➔ The flanges are flush with each other if properly engaged.

Figure 15: Example of output drive A 10.2

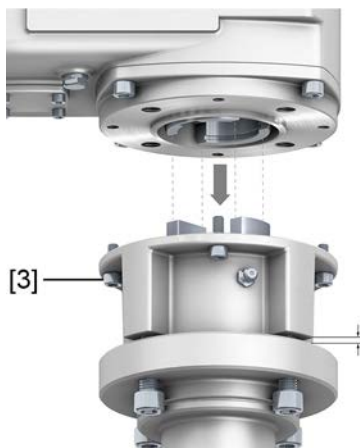

8. Adjust gearbox until alignment of the fixing holes.
9. Fasten gearbox with screws [3].

10. Fasten screws [3] crosswise with a torque according to table.

Table 8: Tightening torques for screws

Screws	Tightening torque T_A [Nm]		
Threads	Strength class		
	8.8	A2-70/A4-70	A2-80/A4-80
M8	25	18	24
M10	51	36	48
M12	87	61	82
M16	214	150	200
M20	431	294	392
M30	1,489	506	1,354
M36	2,594	1,769	2,358


11. Turn gearbox with handwheel in direction OPEN until valve flange and output drive type A are firmly placed together.
12. Tighten fastening screws [5] between valve and output drive type A crosswise applying a torque according to table.

5.4.2.2. Finish machining of stem nut for output drive type A

This working step is only required if stem nut is supplied unbored or with pilot bore.

Information For exact product version, please refer to the order-related technical data sheet or the AUMA Assistant App.

Figure 16: Example of output drive A 10.2

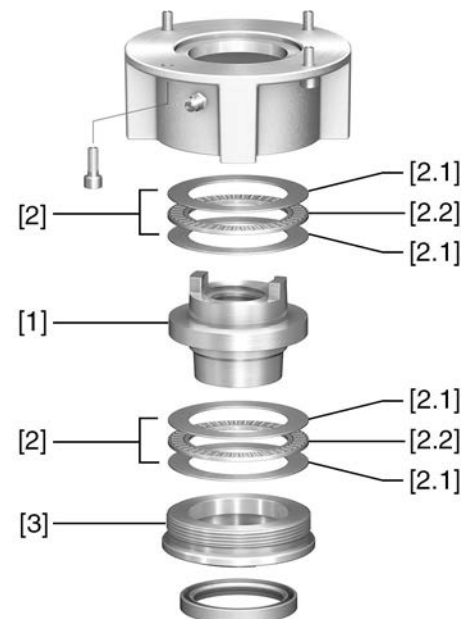

- [1] Stem nut
- [2] Axial needle roller bearing
- [2.1] Axial bearing washer
- [2.2] Axial needle roller and cage assembly
- [3] Spigot ring


- How to proceed**
1. Remove spigot ring [3] from output drive.
 2. Remove stem nut [1] together with axial needle roller bearing [2].
 3. Remove axial bearing washers [2.1] and axial needle roller and cage assemblies [2.2] from stem nut [1].

Information: For output drive types A from size 35.2 and larger: Record the order of axial bearing washers [2.1].

4. Drill and bore stem nut [1] and cut thread.
 5. Clean the machined stem nut [1].
 6. Apply sufficient Lithium soap EP multi-purpose grease to axial needle roller and cage assemblies [2.2] and axial bearing washers [2.1], ensuring that all hollow spaces are filled with grease.
 7. Place greased axial needle roller and cage assemblies [2.2] and axial bearing washers [2.1] onto stem nut [1].
- Information:** For output drive types A from size 35.2: Observe correct order of axial bearing washers [2.1].
8. Re-insert stem nut [1] with axial needle roller bearings [2] into output drive.
 9. Screw in spigot ring [3] until firm seat against the shoulder.

5.4.3. Output drive types B/C/D and E

Figure 17: Mounting principle

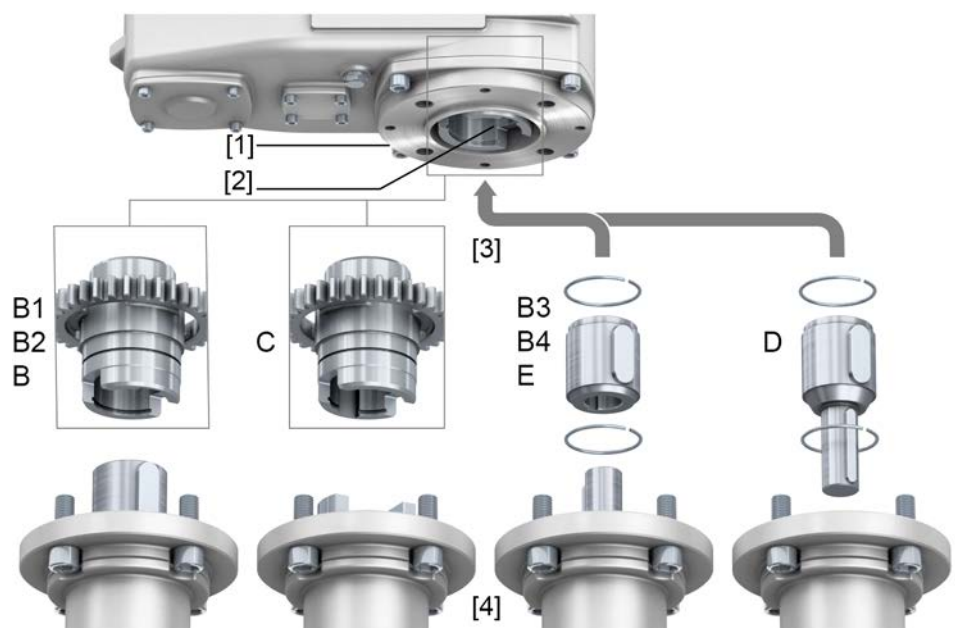

- [1] Flange/gearbox
 [2] Hollow shaft
 [3] Output drive sleeve (illustration examples)
 [4] Valve shaft (example with key)

Short description

Connection between hollow shaft and valve via output drive sleeve fixed to the hollow shaft of the gearbox via retaining ring.

When exchanging the output drive sleeve, later retrofitting to a different output drive type is possible


- Output drive type B/E:
Output drive sleeve with bore according to DIN 3210
- Output drive types B1/B3:
Output drive sleeve with bore according to EN ISO 5210
- Output drive types B2/B4:
Output drive sleeve with bore according to customer order
B4 including special bores like bores without keyway, square bore, hexagon bore, internal splines
- Output drive type C:
Output drive sleeve with dog coupling according to EN ISO 5210 or DIN 3338
- Output drive type D:
Shaft end with key according to EN ISO 5210 or DIN 3210

Information The variants shown in the figure are not applicable for versions with reduction flange.

Information Spigot at valve flanges should be loose fit.

5.4.3.1. Mount gearbox with output drive types B to valve

Figure 18: Mounting output drive types B

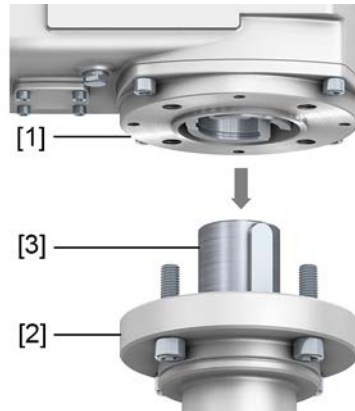

- [1] GST gearbox
- [2] Valve
- [3] Valve shaft

1. Check if mounting flanges fit together.
2. Check, if output drive of gearbox [2] matches the output drive of valve/valve shaft [2/3].
3. Apply a small quantity of grease to the valve shaft [3].
4. Fit gearbox [1].

Information: Ensure that the spigot fits uniformly in the recess and that the mounting faces are in complete contact.

5. Fasten gearbox with screws.

Information: We recommend applying liquid thread sealing material to the screws to avoid contact corrosion.

6. Fasten screws crosswise to a torque according to table.


Table 9: Tightening torques for screws

Screws	Tightening torque T_A [Nm]		
Threads	Strength class		
	8.8	A2-70/A4-70	A2-80/A4-80
M8	25	18	24
M10	51	36	48
M12	87	61	82
M16	214	150	200
M20	431	294	392
M30	1,489	506	1,354
M36	2 594	1,769	2,358

5.5. Accessories for assembly

5.5.1. Stem protection tube for rising valve stem

Figure 19: Assembly of the stem protection tube

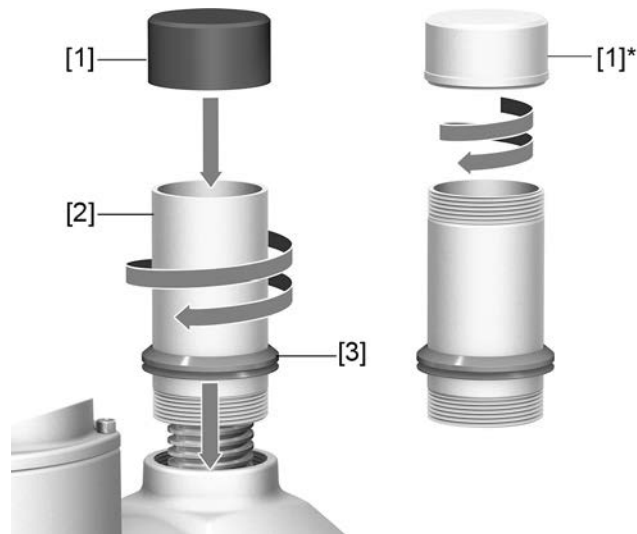


- [1] Protective cap for stem protection tube (fitted)
- [1]* Option: Protective cap made of steel (screwed)
- [2] Stem protection tube
- [3] V-seal

How to proceed

1. Seal all threads with hemp, Teflon tape, sealing agent or thread sealing material.
2. Screw stem protection tube [2] into thread and tighten it firmly.

Information: For stem protection tubes made of two or more segments, all parts have to be thoroughly screwed together.

Figure 20: Protection tube made of segments with threaded sleeves

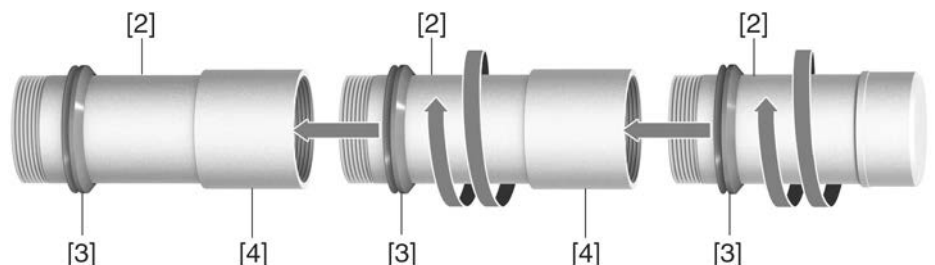

- [2] Segment of stem protection tube
- [3] V-seal
- [4] Threaded sleeve

3. Push down the sealing ring [3] onto the housing.
Information: For mounting segments, push down seals of segments down to the sleeve (connecting piece).
4. Check whether protective cap [1] for stem protection tube is available, in perfect condition and tightly placed on or screwed to the tube.

NOTICE

Risk of bending or oscillation of protection tubes exceeding a length of 2 m!

Risk of damage at stem and/or protection tube.

→ Secure protection tubes exceeding 2 m by an appropriate support.

6. Commissioning

6.1. Seating via multi-turn actuator

This chapter supplies basic information and instructions which should be considered in addition to the operation instructions of the multi-turn actuator.

- The valve manufacturer has to determine whether the valve is limit or torque seated.
- End position seating must be set in compliance with the operating instructions pertaining to the multi-turn actuator.
- For limit seating, determine overrun, i.e. how much does the valve move after the motor has been switched off?
- When setting the torque switching within the multi-turn actuator, make sure that the tripping torque for both directions does not exceed the max. gearbox input torque (refer to technical data or name plate).
- Set the torque switching within the multi-turn actuator to the following value to prevent damage to the valve:
Tripping torque = valve torque/factor (refer to name plate)

7. Servicing and maintenance



Damage caused by inappropriate maintenance!

- Servicing and maintenance must be carried out exclusively by suitably qualified personnel having been authorised by the end user or the contractor of the plant. Therefore, we recommend contacting our service.
- Only perform servicing and maintenance tasks when the device is switched off.

AUMA Service & Support

AUMA offers extensive service such as servicing and maintenance as well as customer product training. For the contact addresses, refer to our website (www.auma.com).

7.1. Preventive measures for servicing and safe operation

- Before commissioning, perform visual inspection for grease leakage and paint damage (corrosion).
- Thoroughly touch up any possible damage to paint. Original paint in small quantities can be supplied by AUMA.

After six months and then once a year: Check gearbox for damage as well as for grease and oil leakage.

7.2. Maintenance intervals

Recommendation for plants subject to strong vibration

- For plants subject to strong vibration, 6 months after commissioning and then once a year: Check fastening screws between actuator and gearbox/valve for tightness. If required, fasten screws while applying the tightening torques as indicated in chapter <Assembly>. For screws sealed and secured with e.g. thread sealing material, this action is not required.

Recommendation for grease change and seal replacement:

- If rarely operated (typically in buried service), the gearboxes are maintenance-free. Grease change or re-lubrication is not necessary.
- If operated frequently (typically in modulating duty), we recommend changing both grease and seals after 4 – 6 years.

NOTICE

Gearing damage due to using inappropriate grease!

- Only use original lubricants supplied by AUMA.
- Do not mix lubricants.

When deployed in areas where dust formation represents a potential explosion hazard, perform visual inspection for deposit of dirt or dust on a regular basis. Clean devices if required.

Check gearbox for unusual running or grinding noise or vibration which might be an indication of bearing or gear damage.

7.3. Disposal and recycling

Our devices have a long lifetime. However, they have to be replaced at one point in time. The devices have a modular design and may, therefore, easily be separated and sorted according to materials used, i.e.:

- Various metals
- Plastic materials
- Greases and oils

The following generally applies:

- Greases and oils are hazardous to water and must not be released into the environment.

- Arrange for controlled waste disposal of the disassembled material or for separate recycling according to materials.
- Observe the national regulations for waste disposal.

8. Technical data

Information The following tables include standard and optional features. For detailed information on the customer-specific version, refer to the order-related data sheet. The technical data sheet can be downloaded from the Internet in both German and English at **<http://www.auma.com>** (please state the order number).

8.1. Technical data Multi-turn gearboxes

Features and functions			
Type of duty	- Short-time duty S2 - 15 min (open-close duty) - Intermittent duty S4 - 25 % (modulating duty)		
Direction of rotation	Standard:	Clockwise rotation at input shaft results in clockwise rotation at output drive	
	Option:	GST 10.1 – GST 30.1: Reversal of direction of rotation by GW 14.1 reversing gearbox	
Stages	Single stage:	GST 10.1 – GST 16.1	
	Double stage:	GST 25.1 – GST 40.1	
Input shaft	For standard reduction ratio, the input shaft is made of stainless steel.		
	Exception:	GST 16.1:	5.6:1
		GST 40.1:	22:1 and 16:1
	Standard:	Cylindrical with parallel key according to DIN 6885-1 (refer to table on page 1), without second shaft end	
	Options:	Square:	- conical (DIN 3233) - cylindrical
		With respect to size, please contact AUMA	
- Input shaft with second shaft end - Input shaft with second shaft end and protective cap			

Technical data

Operation																		
Motor operation	- With electric multi-turn actuator (maximum permissible input speed (240 rpm)) - Input mounting flanges for multi-turn actuator (refer to table page 2)																	
Manual operation	Available handwheel diameters according to EN 12570, selection according to output torque:																	
	Type	GST 10.1			GST 14.1				GST 14.5			GST 16.1						
	Reduction ratio	1:1	1.4:1	2:1	1.4:1	2:1	2.8:1	4:1	2:1	2.8:1	4:1	2.8:1	4:1	5.6:1	2.8:1	4:1	5.6:1	
	Handwheel Ø [mm]	200			315		250		315			400			315			
	Type	GST 25.1				GST 30.1				GST 35.1								
	Reduction ratio	3:1	4:1	5.6:1	8:1	5.6:1	8:1	11:1	3.28:1	8:1	11:1	16:1	7:1	9.25:1				
	Handwheel Ø [mm]	500				500				500								
	Type	GST 40.1																
	Reduction ratio	11:1			16:1			22:1			8:1			14.33:1				
	Handwheel Ø [mm]	500																
Standard:	- Handwheel made of aluminium - Handwheel with ball handle																	
Options:	- Handwheel made of GJL-200 - Handwheel lockable - WSH limit switching device for signalling position and end positions																	
Power tool emergency operation (input shaft with square)	Maximum permissible input speed: 240 rpm																	

Valve attachment		
Valve attachment	A, B1, B2, B3, B4 according to EN ISO 5210 A, B, D, E according to DIN 3210 C according to DIN 3338 Special valve attachments: AF, AK, AG, IB1, IB3, IB4	

Service conditions		
Mounting position	Any position	
Enclosure protection in accordance with IEC 60529	IP68	
	According to AUMA definition, enclosure protection IP68 meets the following requirements: - Depth of water: maximum 8 m head of water - Continuous immersion in water: maximal 96 hours - Up to 10 operations during immersion - Modulating duty is not recommended during immersion.	
Corrosion protection	Standard:	KS Suitable for use in areas with high salinity, almost permanent condensation, and high pollution.
	Option:	KX Suitable for use in areas with extremely high salinity, permanent condensation, and high pollution.
Coating	Double layer powder coating Two-component iron-mica combination	
Colour	Standard:	AUMA silver-grey (similar to RAL 7037)
	Option:	Available colours on request
Lifetime	AUMA multi-turn gearboxes meet or exceed the lifetime requirements of EN ISO 22109. Detailed information can be provided on request.	


Accessories														
Reversing gearboxes		GW reversing gearbox for reversal of rotation direction for manual and motor operation												
Special features for use in potentially explosive atmospheres														
Explosion protection in accordance with ATEX 2014/34/EU	Standard:	II2G c IIC T4 II2D c T130 °C												
	Options:	II2G c IIC T3 II2D c T190 °C IM2 c												
Type of duty	Open-close duty:	Short-time duty S2 - 15 min with the following average output torques:												
	Type	GST 10.1			GST 14.1			GST 14.5			GST 16.1			
	Reduction ratio	1:1	1.4:1	2:1	1.4:1	2:1	2.8:1	2:1	2.8:1	4:1	2.8:1	4:1	5.6:1	
	Average output torque in [Nm]	60			125			150	150	250	300	–		
	Type	GST 25.1			GST 30.1			GST 35.1			GST 40.1			
	Reduction ratio	3:1	4:1	5.6:1	8:1	5.6:1	8:1	11:1	8:1	11:1	16:1	11:1	16:1	22:1
	Average output torque in [Nm]	1,000			2,000			4,000			8,000			
	Modulating duty:	Intermittent duty S4 - 25 % with modulating torque												
Ambient temperature	Standard:	–40 °C to +40 °C (II2G c IIC T4; II2D c T130 °C) –40 °C to +60 °C (II2G c IIC T4; II2D c T130 °C) –60 °C to +60 °C (II2G c IIC T4; II2D c T130 °C)												
	Options:	–40 °C to +80 °C (II2G c IIC T3; II2D c T190 °C) 0 °C to +120 °C (II2G c IIC T3; II2D c T190 °C) –20 °C to +40 °C (IM2 c)												
Further information														
EU Directives		ATEX Directive 2014/34/EU Machinery Directive 2006/42/EC												
Reference documents		Dimensions GST 10.1 – GST 40.1 Technical data SA 07.2 – SA 16.2 Technical data SAR 07.2 – SAR 16.2 Technical data WSH 10.2 – WSH 16.2 Technical data GW 14.1												

9.1. Multi-turn gearboxes GST 10.1 – GST 16.1



Please state device type and our order number (see name plate) when ordering spare parts. Only original AUMA spare parts should be used. Failure to use original spare parts voids the warranty and exempts AUMA from any liability. Representation of spare parts may slightly vary from actual delivery.

Ref. no.	Designation	Type
001.0	Housing	Sub-assembly
002.0	Bearing flange	Sub-assembly
003.0	Hollow shaft	Sub-assembly
004.0	Intermediate stage	Sub-assembly
004.1	Intermediate wheel	Sub-assembly
005.0	Input shaft	Sub-assembly
010.0–1	Bearing cover for second shaft end	Sub-assembly
010.0–2	Protection cover for second shaft end	Sub-assembly
010.0–3	Bearing cover	Sub-assembly
511.0	Threaded plug	Sub-assembly
512.0	Input mounting flange	Sub-assembly
514.0	Output drive type A (without stem nut)	Sub-assembly
514.1	Axial needle roller bearing	Sub-assembly
516.0	Output drive type D	Sub-assembly
516.1	Output drive shaft D	
535.1	Snap ring	
539.0	Screw plug	Sub-assembly
549.0	Output drive type B3/E/B4	Sub-assembly
549.1	Output drive sleeve B3/E/B4	
551.1	Parallel key	
568.1	Stem protection tube (without cap)	
568.2	Protective cap for stem protection tube	
568.3	V-seal	
568.4	Threaded sleeve	
575.1	Stem nut for output drive type A	
595.0	Screw kit for manual gearbox	Sub-assembly
620.1	Eyebolt (available as of GST 16.1)	
S1	Seal kit	Set

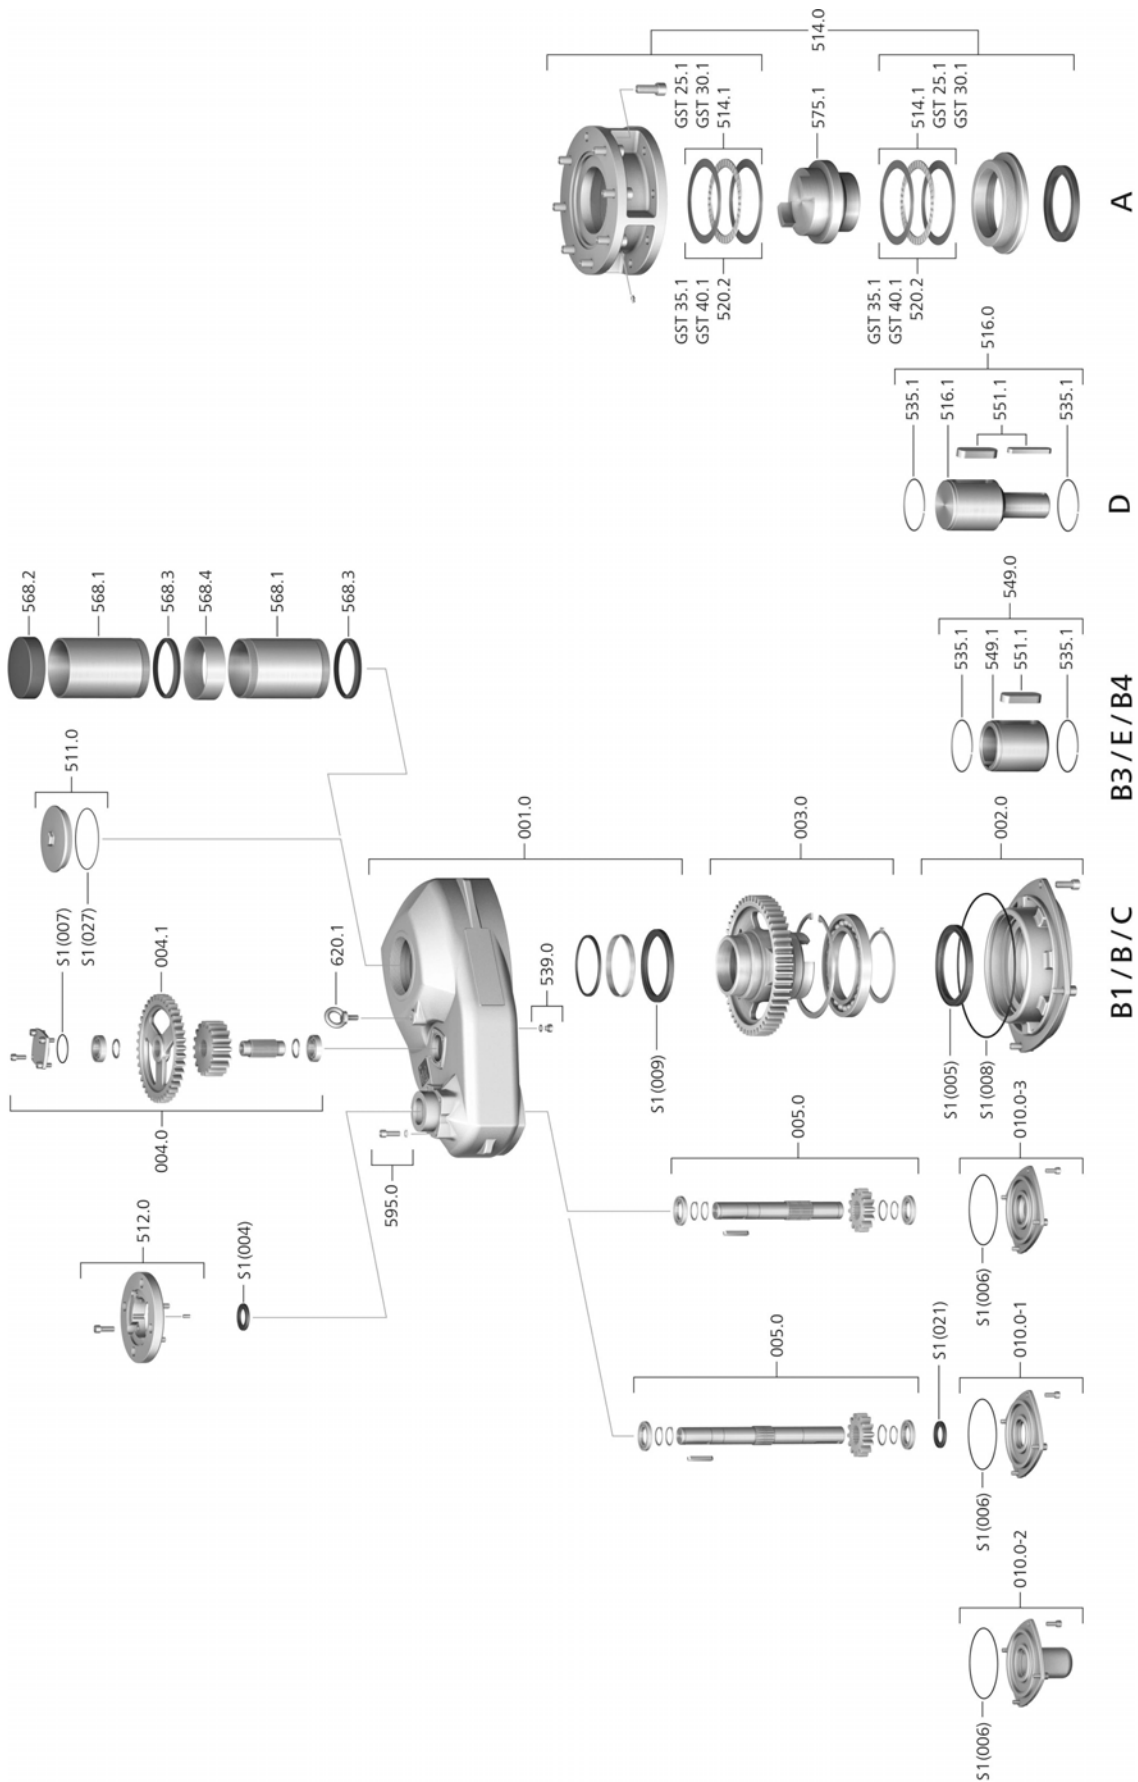

Please state device type and our order number (see name plate) when ordering spare parts. Only original AUMA spare parts should be used. Failure to use original spare parts voids the warranty and exempts AUMA from any liability. Representation of spare parts may slightly vary from actual delivery.

Ref. no.	Designation	Type
001.0	Housing	Sub-assembly
002.0	Bearing flange	Sub-assembly
003.0	Hollow shaft	Sub-assembly
004.0	Intermediate stage	Sub-assembly
004.1	Intermediate wheel	Sub-assembly
005.0	Input shaft	Sub-assembly
010.0–1	Bearing cover for second shaft end	Sub-assembly
010.0–2	Protection cover for second shaft end	Sub-assembly
010.0–3	Bearing cover	Sub-assembly
511.0	Threaded plug	Sub-assembly
512.0	Input mounting flange	Sub-assembly
514.0	Output drive type A (without stem nut)	Sub-assembly
514.1	Axial needle roller bearing	Sub-assembly
516.0	Output drive type D	Sub-assembly
516.1	Output drive shaft D	
520.2	Axial cylinder roller bearing (as of GST 35.1)	Sub-assembly
535.1	Snap ring	
539.0	Screw plug	Sub-assembly
549.0	Output drive type B3/E/B4	Sub-assembly
549.1	Output drive sleeve B3/E/B4	
551.1	Parallel key	
568.1	Stem protection tube (without cap)	
568.2	Protective cap for stem protection tube	
568.3	V-seal	
568.4	Threaded sleeve	
575.1	Stem nut for output drive type A	
595.0	Screw kit for manual gearbox	Sub-assembly
620.1	Eyebolt	
S1	Seal kit	Set

Index**A**

Accessories for assembly	19
Ambient temperature	6
Applications	4
Assembly	12
Assistant App	7
AUMA Assistant App	7

C

Commissioning	3, 20
Corrosion protection	11
Counterclockwise closing	7

D

Data Matrix code	7
Device type	6
Directives	3
Disposal	21

E

Enclosure protection	6
Explosion protection	7

F

Features and functions	23
Flange size	6

H

Handwheel	12
-----------	----

I

Inspection certificate	7
------------------------	---

M

Maintenance	4, 21
Maintenance intervals	21
Mount flange	13
Mounting positions	13
Multi-turn actuators for motor operation	12

N

Name plate	6
------------	---

O

Operation	3
Order number	6, 7
Output drives	14
Output drive type A	14
Output drive types B	17
Output torque (max.)	6

P

Protective measures	3
---------------------	---

Q

Qualification of staff	3
------------------------	---

R

Range of application	4
Recycling	21
Reduction ratio	6
Replacing the seals	21
Reversal of rotation direction	7
Reversing gearboxes	7

S

Safety instructions	3
Safety instructions/warnings	3
Screws to actuator	13
Seating	20
Serial number	6, 7
Service	21
Service conditions	24
Servicing	21
Size	6
Spare parts	26
Standards	3
Stem nut	16
Stem protection tube	19
Storage	11
Support	21

T

Technical data	23
Torque switching	20
Transport	9
Type (device type)	6
Type designation	6
Type of lubricant	6

V

Valve attachment	14
Valve stem	19

Y

Year of production	7, 7
--------------------	------

AUMA Riester GmbH & Co. KG

P.O. Box 1362

DE 79373 Muellheim

Tel +49 7631 809 - 0

Fax +49 7631 809 - 1250

info@auma.com

www.auma.com